
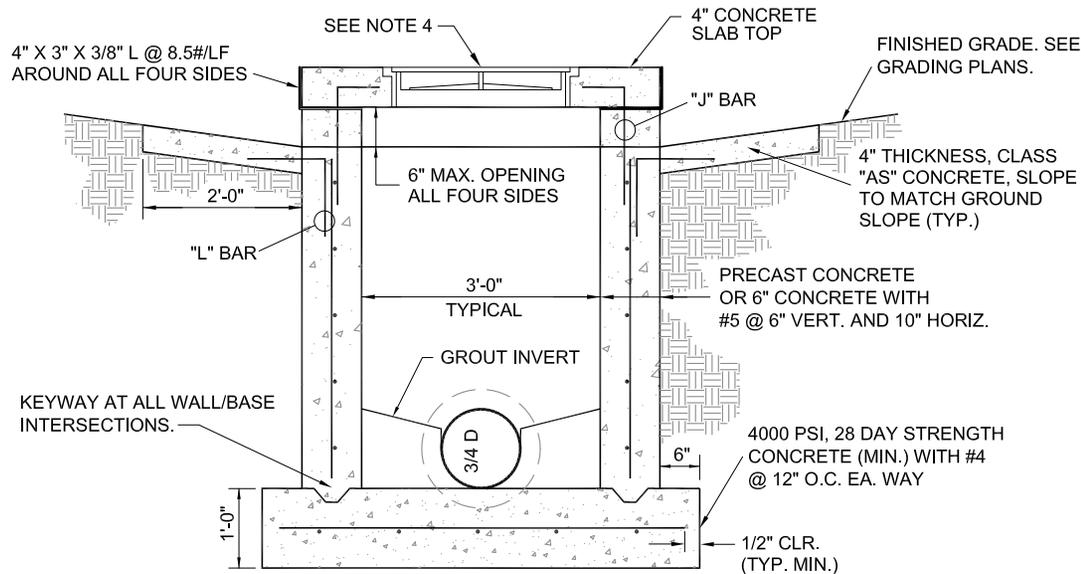




NOTES:

1. INLET TO BE SET ON SUBGRADE COMPACTED TO 95% OF STANDARD PROCTOR (ASTM D-698)
2. PIPE DIAMETER, DEPTH AND DIRECTION SHALL BE DICTATED BY THE PROJECT GRADING AND DRAINAGE PLAN.
3. PRECAST TOPS MUST BE SET IN PLACE USING A FULL BED OF MORTAR.
4. INLET SHALL BE EQUIPPED WITH A CITY OF LAKELAND MANHOLE RIM AND COVER.
5. ALL CONCRETE SHALL BE CLASS "AS", 4000 PSI 28 DAY STRENGTH, MINIMUM.



**SECTION**

**STANDARD  
3' X 3' INLET**  
NOT TO SCALE

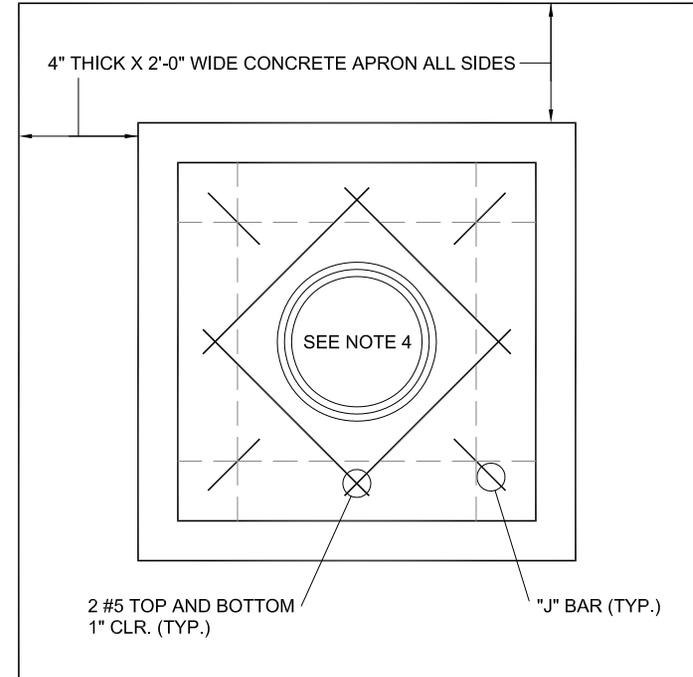

**PLAN VIEW**

*CITY OF LAKELAND  
ENGINEERING DIVISION*

**STANDARD  
3' X 3' INLET**

REV.	DESCRIPTION	DATE
1	ORIGINAL ISSUE	8/2008