



DETACHED SIDEWALK - BACK TO BACK RAMP

DIAGONAL CORNER- BACK TO BACK RAMP

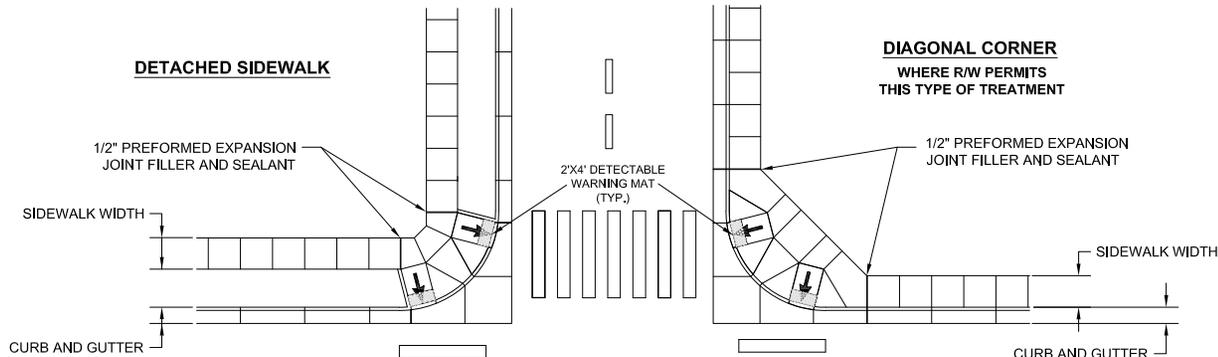

DETACHED SIDEWALK

**DIAGONAL CORNER
WHERE R/W PERMITS
THIS TYPE OF TREATMENT**

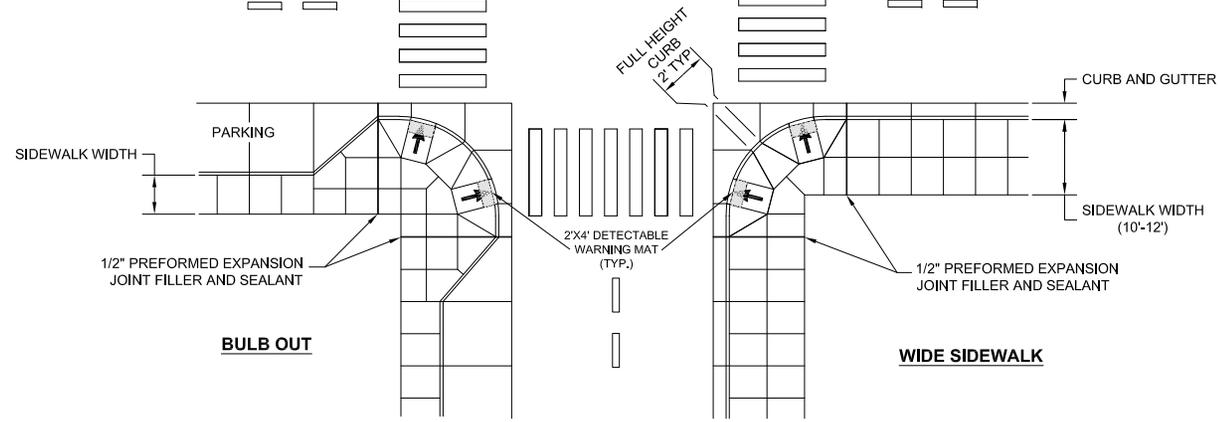

BULB OUT

WIDE SIDEWALK

TYPICAL CURB RAMP TYPE I TREATMENTS

GENERAL SIDEWALK REQUIREMENTS FOR ADA ACCESSIBILITY

NOT TO SCALE

GENERAL SIDEWALK AND ADA REQUIREMENTS

SIDEWALKS SHALL BE CONSTRUCTED TO PROVIDE ACCESSIBILITY CONSISTENT WITH THESE SPECIFICATIONS AND ADA STANDARDS UNLESS OTHERWISE SHOWN IN THE PLANS OR DIRECTED BY THE ENGINEER.

MINIMUM SIDEWALK WIDTH SHALL BE 5 FEET. THE MINIMUM WIDTH FOR AN ACCESSIBILITY ROUTE IS 36".

THE CROSS-SLOPE ON SIDEWALKS AND CURB RAMP SHALL NOT EXCEED 1:48. ALL SIDEWALKS SHALL BE SLOPED 1:48 TOWARDS THE CURB AND GUTTER UNLESS OTHERWISE INDICATED TO PROVIDE POSITIVE DRAINAGE. SIDEWALKS SHALL PROVIDE A MINIMUM OF 36" CLEAR PASSAGE AROUND DRIVEWAYS AND OTHER FEATURES TO PREVENT EXCEEDING THE MAXIMUM CROSS-SLOPE.

CURB RAMP SHALL BE PROVIDED AT STREET INTERSECTIONS AND ELSEWHERE AS SHOWN ON THE PLANS. RAMP SHALL ALSO BE PROVIDED AT ANY OTHER LOCATION WHERE A CROSSWALK OR WHEELCHAIR ACCESS IS NEEDED AS DETERMINED BY THE ENGINEER.


CURB RAMP SHALL BE MEASURED AND PAID FOR AS CONCRETE SIDEWALK AND WILL INCLUDE CURB RETURNS AND INTERIOR CURBS. THE AREA OF THE CURB RAMP THAT FALLS ON THE STREET SIDE OF THE BACK OF CURB LINE WILL BE MEASURED AND PAID FOR AS CURB AND GUTTER OR AS DETERMINED BY THE ENGINEER.

STREET DRAINAGE STRUCTURES SHALL NOT BE PLACED IN LINE WITH CURB RAMP NOR IN THE PATH OF PEDESTRIANS. GRATINGS AND ACCESS COVERS SHALL NOT BE PLACED IN SIDEWALK CURB RAMP.

SIDEWALKS AND CURB AND GUTTER SHALL BE CONSTRUCTED WITH 1/2" PREFORMED EXPANSION JOINT FILLER AT RADIUS POINTS, JUNCTIONS WITH EXISTING CONCRETE, INTERSECTIONS OF CONCRETE SIDEWALK RUNS, AT THE JUNCTURE OF CURB AND GUTTER AND SIDEWALK WHEN THE STREET PAVEMENT IS CONCRETE, AROUND INLETS, AROUND MANHOLES, AROUND OTHER STRUCTURES AND AT INTERVALS. PREFORMED EXPANSION JOINTS SHALL BE SEALED WITH AN APPROVED SILICONE JOINT SEALANT.

CURB RAMP SHALL BE TYPE I OR TYPE I MODIFIED UNLESS OTHERWISE SHOWN IN PLANS.

4" THICKNESS CLASS "AS" CONCRETE, 4000 PSI.

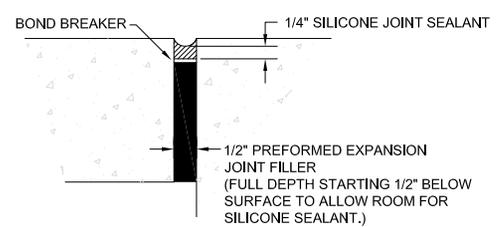

CITY OF LAKELAND ENGINEERING DIVISION		
GENERAL SIDEWALK REQUIREMENTS FOR ADA ACCESSIBILITY		
REV.	DESCRIPTION	DATE
1	ORIGINAL ISSUE	8/2008